



THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF VTE INCORPORATED. ANY REPRODUCTION IN PART OR WHOLE WITHOUT THE WRITTEN PERMISSION OF VTE INCORPORATED IS PROHIBITED. VTE MAKES NO WARRANTY, EXPRESSED OR IMPLIED, AS TO THE SUITABILITY OF A PRODUCT FOR ANY INTENDED USE. THE CUSTOMER SHALL BEAR THE SOLE RESPONSIBILITY OF DETERMINING THE SUITABILITY OF ANY VTE PRODUCT FOR ITS END USE.

LTR.	REVISIONS	DATE	INT.
⚠	UPDATED TORQUE VALUES FROM 180 IN-LBS (20.3 Nm)	2-03-18	RAS
B	REMOVED TORQUE TAG	3-24-26	RAS





USE GREENLEE PUNCH
ASSEMBLY #60098
FOR PANEL CUTOUT

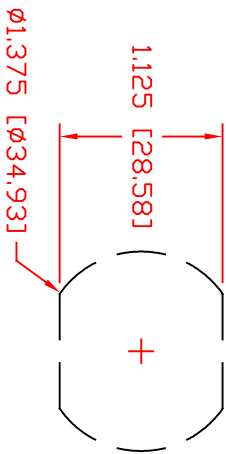

- ASSEMBLY
CCFB106N14W
CONSIST OF :
- 1-CCFB106N14
POWER BUSHING
 - 1-3960-002
SEALING GASKET
 - 1-232N3V14
INSULATOR BOOT

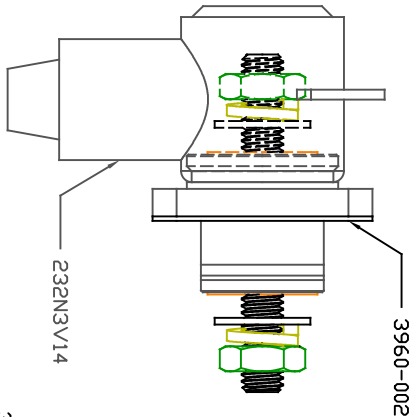

P/N 3960-002
.062 THICK CF 4480 81 DURDMETER
FIBERGLASS REINFORCED SILICONE
PRESS PAD SEALING GASKET

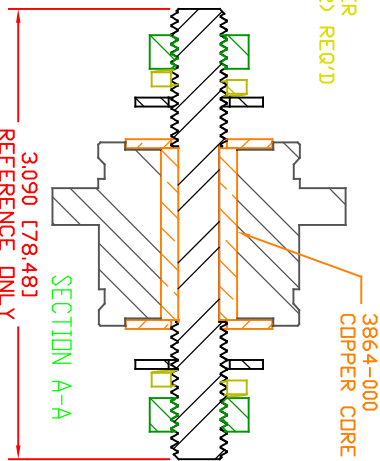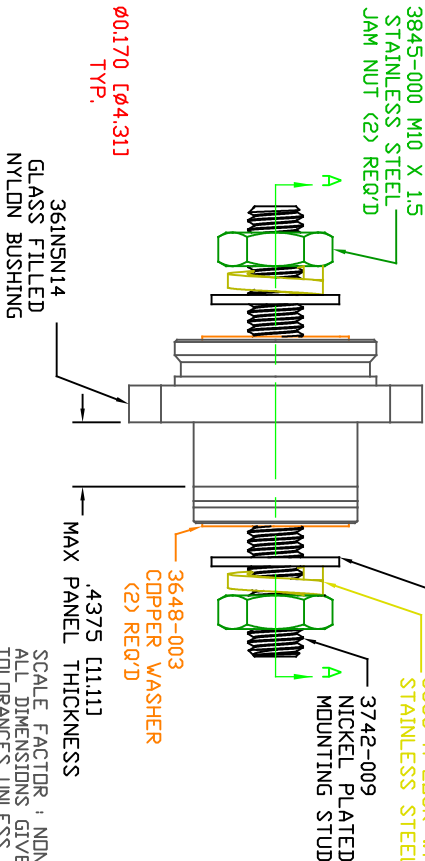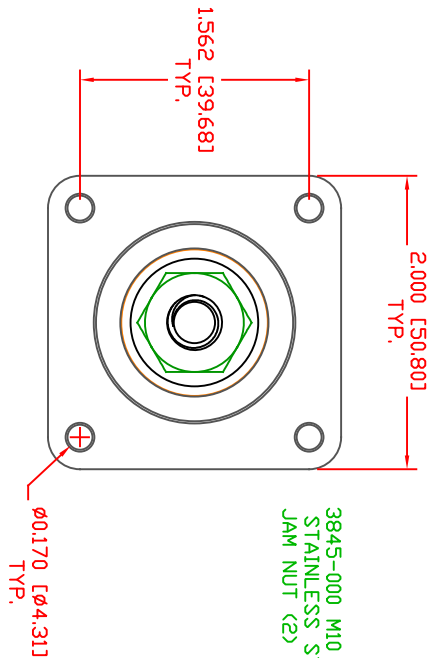

MAXIMUM FASTENER TORQUES:
JAM NUTS: 212 IN-LBS [24.0 Nm]

CURRENT CARRYING CAPACITY:
DUTY CYCLE:
CURRENT CAPACITY:
TEMPORARY MAX (12 MINUTES)
MATERIAL PART NO:
MATERIAL:
VENDOR PART NO:
SPECIFIC GRAVITY:
MELTING TEMP:
UL RATING:

80%,
4.3 Kw (360 AMP @ 12VDC)
5.4 Kw (450 AMP @ 12VDC)
111210514UL
GLASS FILLED NYLON
NYLON N2015 HL BK
1.23
515 F [268 C]
UL 94 HB

SCALE FACTOR : NONE
ALL DIMENSIONS GIVEN AS: In (mm)
TOLERANCES UNLESS OTHERWISE SPECIFIED :
MOLDED PARTS: ±.030" [±0.8mm]
HARDWARE ITEMS: ±.010" [±0.25mm]



VTE Incorporated
5437 Robinson Road, P.O. Box 790
Pellston, Michigan 49769
Telephone: 1-800-527-9256, 231-539-8000
FAX: 231-539-0914

REF.	DATE	DRN BY:	RAS	WEIGHT:
CUSTOMER DIMS	11-16-17	CHK'D BY:	PJK	
TITLE: 10MM PANEL MOUNT POWER BUSHING, COPPER CORE				
MATERIAL: GLASS FILLED NYLON				PART NO:
COLOR: BLACK	DRG CLASS	REV B	CCFB106N14W	